
Touch



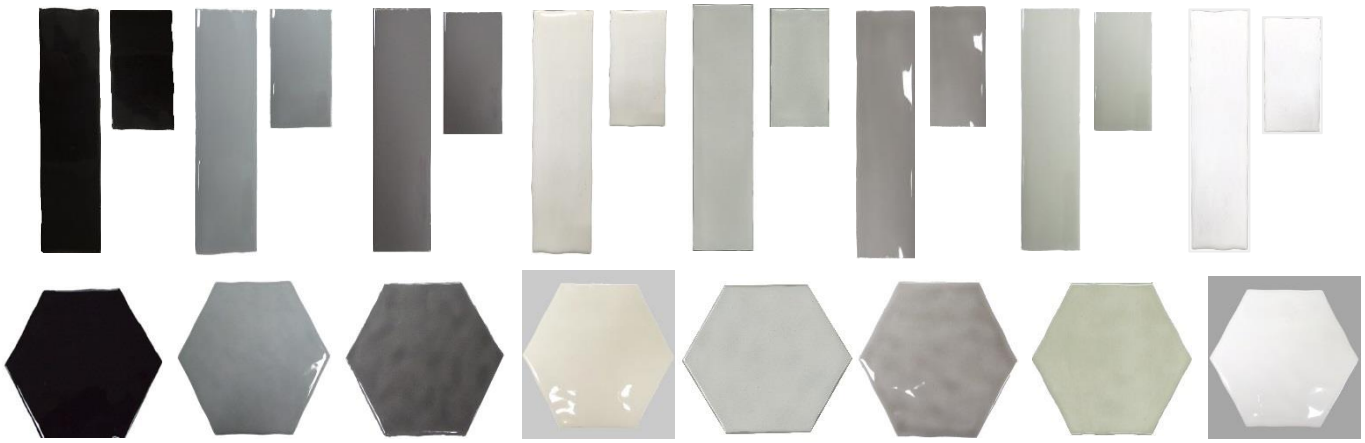

These classically designed subway tiles provide a time-honored ambience to any bathroom or kitchen. The Touch series combines the traditional feel of handmade subway tiles with eight contemporary colours imbuing a modern touch to the original tile.

- **Gloss Colours** Black, Blue, Charcoal, Cream, Grey, Latte, Sage & White
- **Gloss Sizes** 75x150 & 75x300mm
  With matching 130x150mm gloss hexagons
- **Satin Colours** Black & White
- **Satin Sizes** 75x150 & 75x300 mm

V2 Variation

Wall Cat. 0

GNS Ceramics recommends that our retail shops pass on the following information to the installer and end-user.


Ceramic tiles are only one component of a much larger building system. It is our experience that failure of any tiling system is very often the result of a combination of factors. For example; inappropriate design, type of substrate, surface preparation, temperature during installation, adhesives, incompatibility of products, product failure, environmental factors skill and knowledge of the installers etc; the latter being supplied or controlled by a variety of manufacturers and tradesmen. GNS Ceramics has no involvement in the design, selling and installation processes and once goods have been dispatched from our warehouse we have no control over where and how these products are used. As a result the project manager, and or the tiler are the only people in a position to ensure that all the components used in a project are compatible and that the product is installed in accordance with the Australian Building Code and the Australian Standards.

Installation Instructions for all types of tiles can be found in the GNS Ceramics Price List, and on our website. We suggest these are followed at all times.

Cleaning and Maintenance

Do not use abrasive cleaners and chemicals which could permanently scratch and damage the surface of the tile. For daily cleaning we recommend the use of a mild PH Neutral detergent. Should a more vigorous cleaning programme be required we recommend the use of a proprietary tile cleaner from a specialty tile supplier.

Colour & Pattern Variation Guide

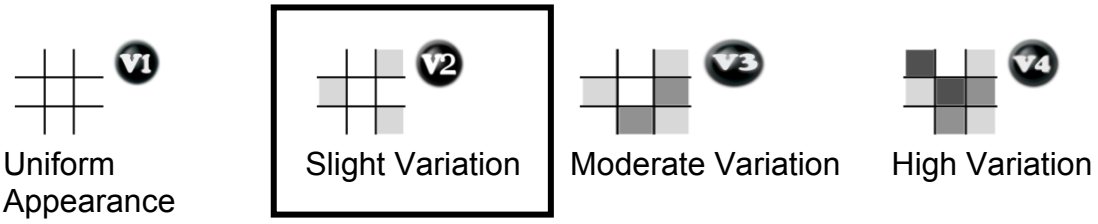

Classes of Use

The classification has taken into account the recommendations of the Australian Standards; however, they are given for general guidance only. They are valid for the given application under **NORMAL CONDITIONS** and should not be taken to provide accurate product specifications for specific requirements.

WARNING: Other standards and building code requirements may affect your selection of tiles. Consideration should be given to the footwear, type of pedestrian traffic and cleaning methods expected. Floors should be adequately protected against soiling from following trades during installation; they should also be protected against scratching dirt at the entrances to building by interposing footwear cleaning devices. For example, mats, shoe scrapers, static devices, etc.

CLASS 0 - Tiles in this class are not recommended for use on floors.

INSPECTION AND QUARANTINE COMPREHENSIVE TECHNOLOGY CENTRE
OF FOSHAN ENTRY-EXIT INSPECTION & QUARANTINE BUREAU

CERTIFICATE
Of Conformity

正本

申请人存

Certificate No: 25201300008

Applicant:

Address of Applicant:

Product: INTERIOR WALL TILE

Type designation: YGN08001, Y-01, Y-10, Y-06, Y1A17001, Y1A17001H, NC75150

Technical data: Dry-pressed ceramic tiles for internal wall finishes with water absorption $E>10\%$, Group BIII, 7.5cm×15cm, Glazed

The submitted samples of the above product have been tested for CE marking according to the following European Regulation:

(EU)No.305/2011- the Construction Products Directive

Standard used for showing compliance with the essential requirements in the specified directive:

Standard	Test report	Issued by	Date
EN 14411:2006	**25201300008**	**IQCTC of FSCIQ**	**Jan. 25, 2013**

The referred test report shows that the product complies with standard recognized as giving presumption of compliance with the essential requirements in the specified EU Directive.
After preparation of the necessary technical documentation as well as the conformity declaration the CE marking as shown below can be affixed on the product. Other relevant Directives have to be observed.
*This certificate is **NOT** valid for: i) uses in suspended ceilings; ii) uses subject to requirements against accidental fall of objects on to transit areas; iii) uses subject to dangerous substances regulations; iv) uses in vehicular circulation areas.*
This document is the property of Inspection and quarantine comprehensive technology centre of Foshan Entry-exit Inspection & Quarantine Bureau, and it is not transferable. Only the applicant may reproduce this certificate.

CE

LIANG BAIQING
Director

Issue Date: Jan. 25, 2013
Expiration Date: Jan. 24, 2014

Note: This certificate is part of the full report and should be read in conjunction with it.

INSPECTION AND QUARANTINE COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN ENTRY-EXIT INSPECTION & QUARANTINE BUREAU
2/F, Building 18, Lanshi International Metal Exchange Center, Kuiqiyi Road, Chancheng District, Foshan, Guangdong, China (528000)
TEL: 86-757-83960558 FAX: 86-757-83827971

25201300008

CE 13 EN 14411 .Dry-pressed ceramic tiles for interior wall finishes, Group BIII	CHARACTERISTICS Reaction to fire Breaking strength Modulus of rupture Release of dangerous substances	DECLARED VALUE Class A1fl (Decision 96/603/EEC as amended) ⩾200N (EN ISO 10545-4) ⩾15N/mm^2 (EN ISO 10545-4) NPD

2010002473Z

检 测 报 告

TEST REPORT

报 告 编 号:
REPORT NO. : 25201300008

样 品 名 称:
NAME OF SAMPLE: 釉面内墙砖 INTERIOR WALL TILE

委 托 单 位:
APPLICANT:

检 验 日 期:
DATE OF TEST: 05/01/2013 – 14/01/2013(DD/MM/YY)

国 家 建 筑 卫 生 陶 瓷 检 测 重 点 实 验 室
STATE KEY TESTING LABORATORY OF BUILDING CERAMICS AND SANITARY WARE
佛山出入境检验检疫局检验检疫综合技术中心
INSPECTION AND QUARANTINE COMPREHENSIVE TECHNOLOGY CENTRE
OF FOSHAN ENTRY-EXIT INSPECTION & QUARANTINE BUREAU

佛山出入境检验检疫局检验检疫综合技术中心
INSPECTION AND QUARANTINE COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN ENTRY-EXIT INSPECTION & QUARANTINE BUREAU

检测报告
TEST REPORT

报告编号： 25201300008 共 5 页 第 2 页
Report No: Page 2 of 5

样品名称 Name of Sample	釉面内墙砖 INTERIOR WALL TILE	公称尺寸 Nominal Size	7.5cm×15cm
型号 Type	有釉砖 GLAZED	工作尺寸 Work size	75mm×150mm×6.8mm
类别 Group	BⅢ （E>10%）	样品数量 Quantity of Samples	1 箱 1 Box
样品记号 Mark of Samples	NC75150	样品描述 Description of Samples	样品完好,适合测试 The samples are sound, intact and fit for test.
委托单位 Applicant		委托单位地址 Address of Applicant	
委托单位电话 Telephone of Applicant		委托单位传真 Fax of Applicant	
样品来源 Source of Samples	委托单位自送样品 Samples selected by applicant	接样日期 Received on	31/12/2012
检验依据 Test Standard	EN 14411：2006 *Ceramic tiles – Definitions, classification, characteristics and marking* Annex L Dry-pressed ceramic tiles E>10% Group BⅢ		
检验结论 Conclusion of Test	样品经检验,所检验项目的检验结果符合 EN 14411：2006 标准中附录 L 的规定。 The results conform to the requirement of Annex L of standard EN 14411：2006 with respect to the test items.		
检验单位盖章 Stamp of Inspection Unit	日期：25/01/2013 Date:	检验单位地址 Address of Inspection Unit	广东省佛山市禅城区魁奇一路澜石（国际）金属交易中心十八座二楼 2/F, Building 18, Lanshi International Metal Exchange Center, Kuiqiyi Road, Chancheng District, Foshan, Guangdong, China
		检验单位电话 Telephone of Inspection Unit	86-757-83960558
		检验单位传真 Fax of Inspection Unit	86-757-83827971
		邮编 Postal Code	528000
备注 Note	1、未经允许，本报告不得部分复制。 Report shall not be reproduced except in full without the written approval of Inspection Unit. 2、本报告仅是样品的检测结果。 The results in this report apply to the samples only.		

检验负责人 Tested by 审核 Inspected by 批准 Approved by

佛山出入境检验检疫局检验检疫综合技术中心


INSPECTION AND QUARANTINE COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN ENTRY-EXIT INSPECTION & QUARANTINE BUREAU

检测报告

TEST REPORT

报告编号： 25201300008 共 5 页 第 3 页

Report No: **Page 3 of 5**

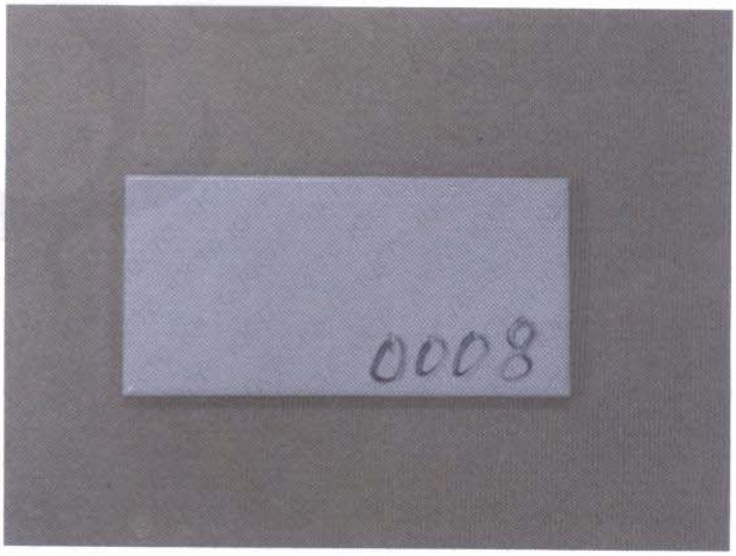委托单位声明 Remark of applicant	送检样品为 7.5cm×15cm 釉面内墙砖，型号为 NC75150。该系列所包含产品型号的吸水率、规格、使用的材料、采用的成型方法（干压）以及表面状态（有釉）是一致的，区别在于外观设计。 **The test report data was based on item No.NC75150, in a family of interior wall tile, 7.5cm×15cm. All items in the family are same in water absorption, dimensions and thickness, material, method of manufacture (dry-pressed) and finish surface characteristics (glazed), except for the design of appearance.**
	本系列所包含的产品型号 Items in the family： YGN08001, Y-01, Y-10, Y-06, Y1A17001, Y1A17001H, NC75150
检测样品照片 Photo of Test Samples	 NC75150

佛山出入境检验检疫局检验检疫综合技术中心
INSPECTION AND QUARANTINE COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN ENTRY-EXIT INSPECTION & QUARANTINE BUREAU

检测报告
TEST REPORT

报告编号： 25201300008 共 5 页 第 4 页
Report No: Page 4 of 5

序号 Sequence Number	检验项目 Test Item	检验标准 Test Method	标准要求 Provisions of Standard	检验结果 Test Result	判定 Judgement
1	尺寸 Dimensions				
	长度和宽度 Length and width	EN ISO 10545-2	每块砖的平均尺寸相对于工作尺寸的允许偏差为 $l \leq 12cm$: ±0.75% $l > 12cm$: ±0.5% The deviation, in percent, of the average size for each tile from the work size: $l \leq 12cm$: ±0.75% $l > 12cm$: ±0.5%	长度 Length ($l > 12cm$) +0.21%~+0.43% 宽度 Width ($l \leq 12cm$) -0.05%~+0.34%	合格 Pass
			每块砖的平均尺寸相对于 10 块砖平均尺寸的允许偏差为 $l \leq 12cm$: ±0.5% $l > 12cm$: ±0.3% The deviation, in percent, of the average size for each tile from the average size of the 10 test specimens: $l \leq 12cm$: ±0.5% $l > 12cm$: ±0.3%	长度 Length ($l > 12cm$) -0.10%~+0.12% 宽度 Width ($l \leq 12cm$) -0.23%~+0.16%	合格 Pass
	厚度 Thickness	EN ISO 10545-2	每块砖厚度的平均值相对于工作尺寸厚度的最大允许偏差±10% The deviation, in percent, of the average thickness of each tile from the work size thickness: ±10%	-0.99%~+0.44%	合格 Pass
2	物理性能 Physical properties				
	吸水率 Water absorption	EN ISO 10545-3	平均值为 $E > 10\%$，单个值不小于 9%。当平均值＞20%时，生产厂家应说明。 Average＞10%, Individual minimum value 9%. When the average exceeds 20%, this shall be indicated by the manufacturer.	平均值: 18.8% 最小值: 18.4% Average: 18.8% Individual minimum: 18.4%	合格 Pass
	破坏强度 Breaking strength	EN ISO 10545-4	厚度＜7.5mm，平均值不小于 200N Thickness＜7.5mm, Not less than 200N	636N	合格 Pass
	断裂模数 Modulus of rupture	EN ISO 10545-4	厚度≤7.5mm，平均值不小于 15MPa Thickness≤7.5mm, minimum 15MPa	24.8MPa	合格 Pass
	抗热震性 Thermal shock resistance	EN ISO 10545-9	试验后，所有样品无裂纹或炸裂。 Test method available	样品经试验，无炸裂或裂纹. Fully resistant	合格 Pass
	抗釉裂性 Crazing resistance	EN ISO 10545-11	试验后,釉面无裂纹或剥落. Required	样品经试验，无裂纹或剥落. Fully resistant	合格 Pass

佛山出入境检验检疫局检验检疫综合技术中心
INSPECTION AND QUARANTINE COMPREHENSIVE TECHNOLOGY CENTRE OF FOSHAN ENTRY-EXIT INSPECTION & QUARANTINE BUREAU

检测报告
TEST REPORT

报告编号： 25201300008 共 5 页 第 5 页

Report No: Page 5 of 5

序号 Sequence Number	检验项目 Test Item		检验标准 Test Method	标准要求 Provisions of Standard	检验结果 Test Result	判定 Judgement
3	化学性能 Chemical properties					
	耐化学腐蚀性 Resistance to chemicals	耐低浓度酸和碱 Resistance to low concentrations of acids and alkalis	EN ISO 10545-13	制造商应报告耐化学腐蚀性等级 Manufacturer to state classification	GLA	----
		耐高浓度酸和碱 Resistance to high concentrations of acids and alkalis	EN ISO 10545-13	报告检验结果 Test method available	GHA	----
		耐家庭化学试剂和游泳池盐类 Resistance to household chemicals and swimming pool salts	EN ISO 10545-13	不低于 GB 级 Minimum GB	GA	合格 Pass
	耐污染性 Resistance to staining		EN ISO 10545-14	不低于 3 级 Minimum Class 3	5 级 Class 5	合格 Pass