GNS CERAMICS
EXCLUSIVELY WHOLESALE

Travertition


Travertition is a cross-cut travertine marble that creates a look that is subtle and elegant. The beauty of Travertition isn't to be enjoyed just on the interior. It can be just as beautiful, just as elegant when used on the outside, surrounding ponds or pools, creating a romantic looking path in a garden, or decorating a patio under the shining stars of the night.




GNS CERAMICS
EXCLUSIVELY WHOLESALE

Travertition


Matt, External

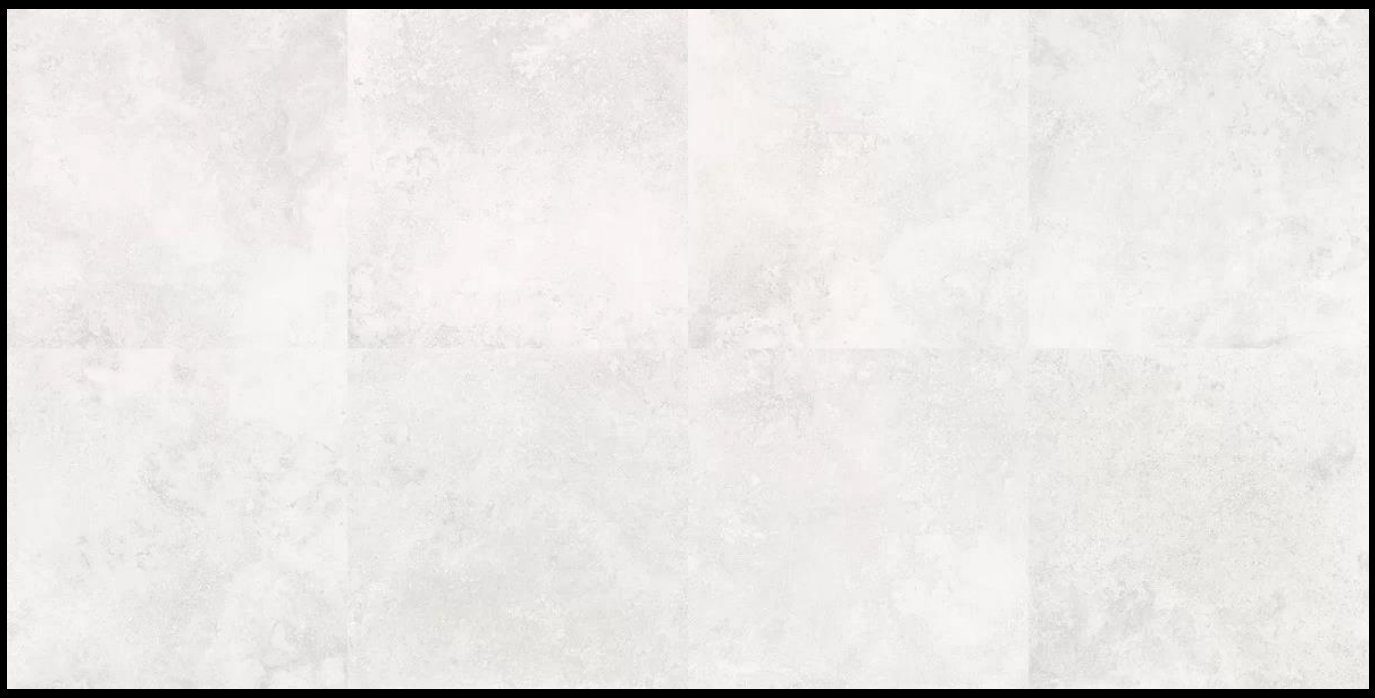

White

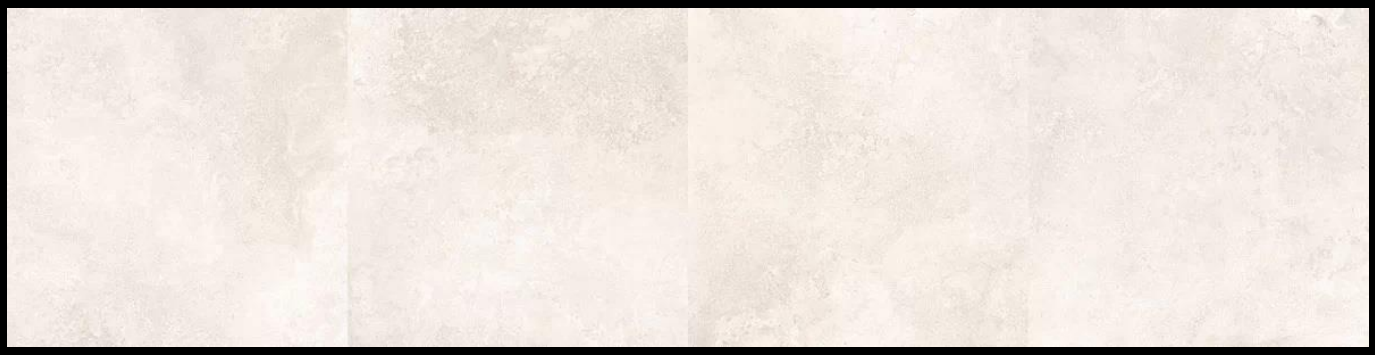

Beige

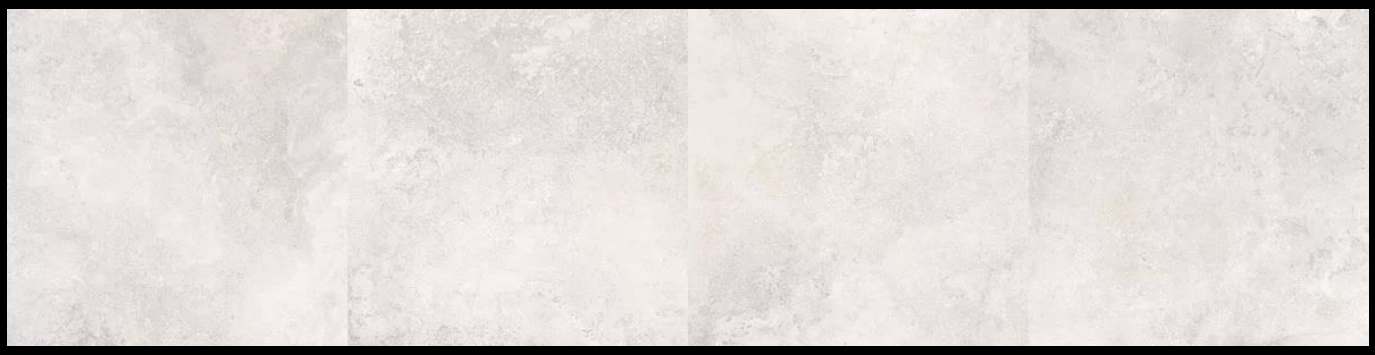

Grey

Glazed Porcelain

600 MM
600 MM

Rectified Edge

V2
Variation

Floor Cat. 4

P5

External

GNS Ceramics recommends that our retail shops pass on the following information to the installer and end-user.

Click or Scan for Installation Instructions


Ceramic tiles are only one component of a much larger building system. It is our experience that failure of any tiling system is very often the result of a combination of factors. For example; inappropriate design, type of substrate, surface preparation, temperature during installation, adhesives, incompatibility of products, product failure, environmental factors skill and knowledge of the installers etc; the latter being supplied or controlled by a variety of manufacturers and tradesmen. GNS Ceramics has no involvement in the design, selling and installation processes and once goods have been dispatched from our warehouse we have no control over where and how these products are used. As a result the project manager, and or the tiler are the only people in a position to ensure that all the components used in a project are compatible and that the product is installed in accordance with the Australian Building Code and the Australian Standards.

Installation Instructions for all types of tiles can be found in the GNS Ceramics Price List, and on our website. We suggest these are followed at all times.

Cleaning and Maintenance

Do not use abrasive cleaners and chemicals which could permanently scratch and damage the surface of the tile. For daily cleaning we recommend the use of a mild PH Neutral detergent. Should a more vigorous cleaning programme be required we recommend the use of a proprietary tile cleaner from a specialty tile supplier.

Colour & Pattern Variation Guide



Uniform Appearance | Slight Variation | Moderate Variation | High Variation

Slip Resistance

The best way to minimise the risk of slipping is through safe design principals. This involves a risk management approach which evaluates the likelihood and consequence of an incident to occur. Slip resistive flooring is only one of the design components to consider, other design features should also be considered, including awnings, airlocks, matting and a suitable cleaning regime to reduce the extent of contaminates. Visual aids, warning signs, handrails and lighting, along with the footwear to be worn, should also be considered.

All ceramic tiles can be slippery, particularly when wet. This includes tiles, commonly used in wet areas such as bathrooms. It is important that customers be aware of the potential danger of wet ceramic tiles and seek advice from the retailer as to the level of slip-resistance of any particular tile, and its suitability for the intended application. If there is any doubt, tiles should be tested for slip-resistance immediately after being laid, under the conditions that they will be subject to during use. While tiles may achieve an acceptable standard in a laboratory test, it is quite probable that the performance in-situ will be less than expected, due to installation methods, wear & tear, cleaning regimes and unforeseen circumstances. Test results should therefore to be seen as a relative guide to estimate the merits of one tile versus another and should be used in conjunction with the Australian Building Code and the relevant Australian Standards. Further information on slip resistance is provided in the Australian Standards HB198:2014 - An Introductory guide to the slip resistance of pedestrian surface materials.

There are many factors beyond the control of the supplier that can affect the level of slip-resistance of tiles, or contribute to the incidents of injury through slipping. Consequently, the laboratory test results presented here must not be viewed to mean that GNS Ceramics Pty Ltd, is providing any warranty, nor will accept any liability for personal injury or accidents arising from the selection or installation of tiles under any circumstances.

Classes of Use

The classification has taken into account the recommendations of the Australian Standards; however, they are given for general guidance only. They are valid for the given application under **NORMAL CONDITIONS** and should not be taken to provide accurate product specifications for specific requirements.

WARNING: Other standards and building code requirements may affect your selection of tiles.

Consideration should be given to the footwear, type of pedestrian traffic and cleaning methods expected. Floors should be adequately protected against soiling from following trades during installation; they should also be protected against scratching dirt at the entrances to building by interposing footwear cleaning devices. For example, mats, shoe scrapers, static devices, etc.

CLASS 4 - Floor coverings that are walked on by regular traffic with some scratching dirt so that conditions are more severe than CLASS 3; For example, entrances, laundries with external access, living areas, entertainment areas, patio's, sales rooms, motels.

Sliptest Australia Pty Ltd
NATA Accreditation No: 15374
11 Fuchsia Way Gaven QLD 4211., Gaven, QLD, 4211
kathryn@sliptest.com.au
www.sliptest.com.au
1300 754 783


DWC Tiles Pty Ltd - TRAVERTITION BEIGE GRIP STTR6002R - Wet Sliptest KO040918-3

04 Sep 2018

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	04 Sep 2018
Test Report Number:	KO040918-3
Client Name & Address:	DWC Tiles Pty Ltd - 13/400 Bilsen Road GEEBUNG QLD 4034
Product / Sample Tested :	TRAVERTITION BEIGE GRIP STTR6002R 600x600
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Record ambient temperature (°C)	20
Testing Officer :	Kathryn Ording - Munro-Stanley Portable Skid Tester #1133 - 30.08.17
Testing Officer Signature	

Test Results :

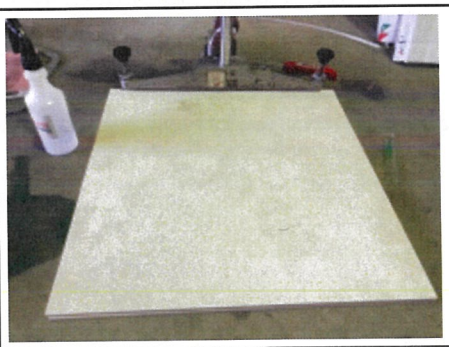No. of Samples	Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
4	1A	65	65	65	65	65	65	
	2A	65	65	65	64	64	64	
	3A	67	67	67	66	66	66	
	4A	67	67	65	65	65	65	
	4B	65	65	65	65	65	65	

CLASSIFICATION using Slider 96 (4S Slider) P5 = > 54

Accedited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results to not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

Sliptest Australia Pty Ltd
NATA Accreditation No: 15374
11 Fuchsia Way Gaven QLD 4211., Gaven, QLD, 4211
kathryn@sliptest.com.au
www.sliptest.com.au
1300 754 783

DWC Tiles Pty Ltd - TRAVERTITION GREY GRIP STTR6001R - Wet Sliptest KO040918-1

04 Sep 2018

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	04 Sep 2018
Test Report Number:	KO040918-1
Client Name & Address:	DWC Tiles Pty Ltd - 13/400 Bilsen Road GEEBUNG QLD 4034
Product / Sample Tested :	TRAVERTITION GREY GRIP STTR6001R 600x600
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Record ambient temperature (°C)	18
Testing Officer :	Kathryn Ording - Munro-Stanley Portable Skid Tester #1133 - 30.08.17
Testing Officer Signature	

Test Results :

No. of Samples	Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
4	1A	60	60	60	60	60	60	
	2A	60	60	58	58	58	58	
	3A	60	60	60	58	58	59	
	4A	65	63	63	63	63	63	
	4B	65	63	63	62	62	62	

Mean BPN Slip Resistance Value (SRV) 60

CLASSIFICATION using Slider 96 (4S Slider) P5 = > 54

Accedited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results to not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

Sliptest Australia Pty Ltd
NATA Accreditation No: 15374
11 Fuchsia Way Gaven QLD 4211., Gaven, QLD, 4211
kathryn@sliptest.com.au
www.sliptest.com.au
1300 754 783

DWC Tiles - TRAVERTITION WHITE GRIP TILES 600X600 TILES - Wet Sliptest Report - KO191019-1

19 Oct 2019

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	19 Oct 2019
Test Report Number:	KO191019-1
Client Name & Address:	DWC Tiles Pty Ltd - 13/400 Bilsen Road GEEBUNG QLD 4034
Test Site / Surface Tested :	TRAVERTITION WHITE GRIP TILES 600X600 TILES
Sample Information :	Samples and Test Information Supplied by Client
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Record ambient temperature (°C)	23
Testing Officer :	Kathryn Ording
Testing Officer :	#0604 - Munro Portable Skid Tester #0604 - 06.02.18
Testing Officer Signatory:	

Test Results :

Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
Tile 1A	80	78	78	78	78	78	
Tile 1B	76	76	75	75	75	75	
Tile 1C	78	78	78	78	78	78	
Tile 2A	78	78	76	76	76	76	
Tile 3B	78	76	76	76	76	76	

Mean BPN Slip Resistance Value (SRV) 77

CLASSIFICATION using Slider 96 (4S Slider) P5 = > 54

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results to not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

Page 1 of 1 - END OF REPORT